
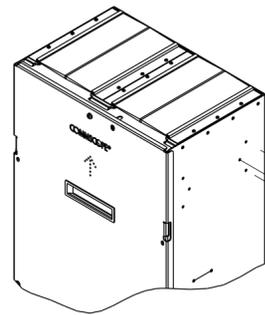


SPLICE CABINET ODF-SPLCAB-12 2 POST RACK MOUNTING

| REVISIONS | | | |
|-----------|-------------|------------|----------|
| REV | CMO | DATE | APPROVED |
| A | 40105152CMO | 6-MAR-2020 | RCS |









MOUNTING BRACKET
STAR WASHER
M6 SCREW (8mm LONG)


2 POST RACK
MOUNTING BRACKET POSITION

RACK MOUNT SPLICE CABINET
IMPORTANT: MOUNT SPLICE CABINET TO RACK
WITH DOOR FASTENED TO CABINET.

COMMSCOPE RK6-45A-ZA
6" SEISMIC RACK (REF)

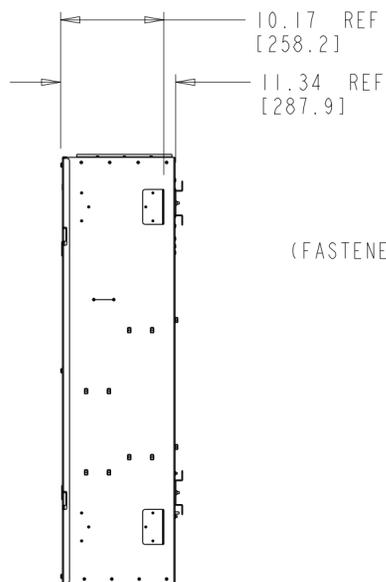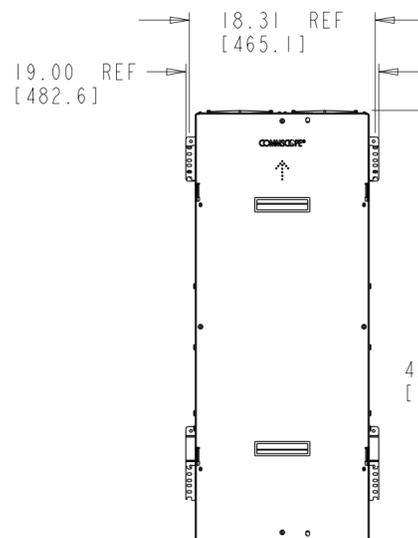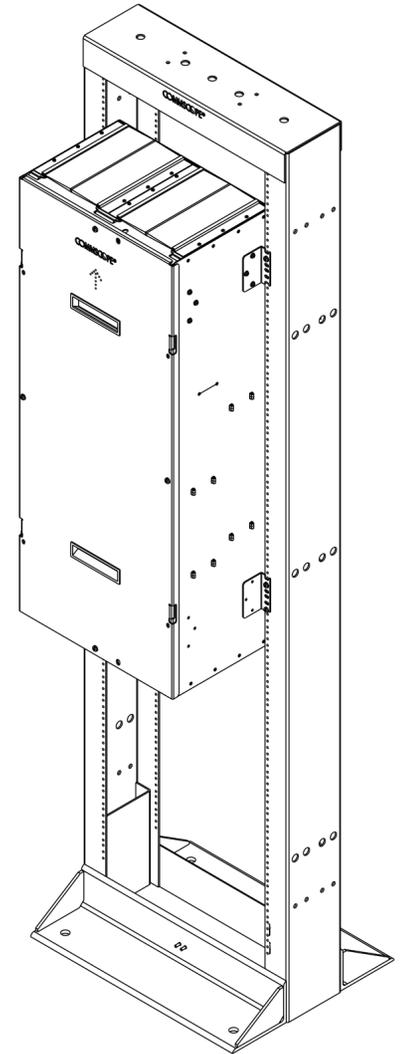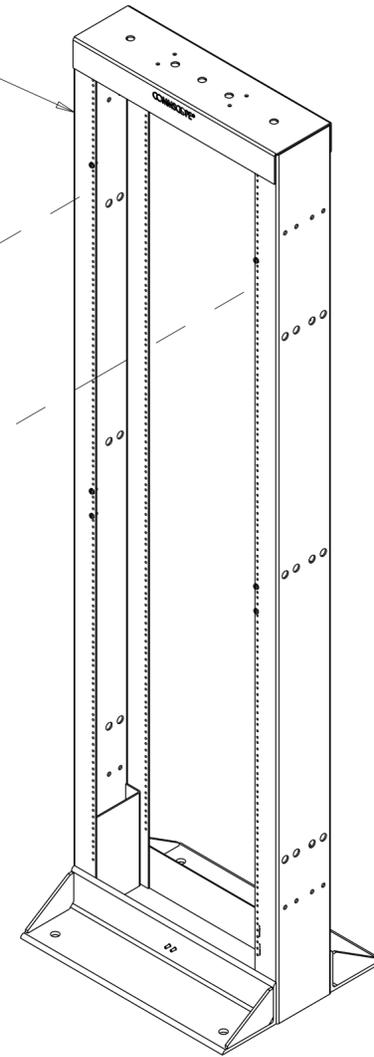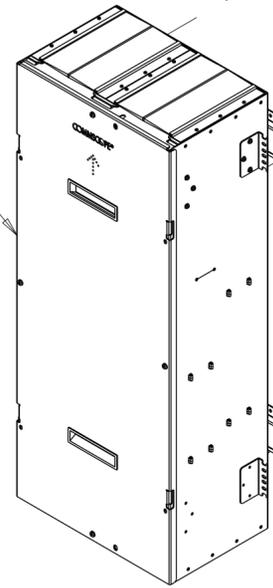

GROUND LOCATION
#10-32 THREADS
(FASTENERS NOT PROVIDED)

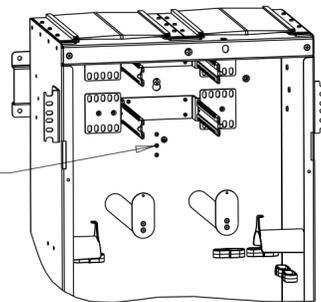

SPLICE CABINET MOUNTING OPTIONS

1. RACK MOUNTING: 19" OR 23" WIDE RACKS. 19" SHOWN.
2. 4 POST RACK OR CABINET MOUNTING (19" OR 23")
3. WALL MOUNT

NOTES:

1. USES UP TO 12 COMMSCOPE 288F SPLICE TRAYS.
TRAY PN: 760243050 (FOST-ACC-D-TRAY-RR-288-KIT)
2. MAXIMUM CAPACITY: 3456 FIBERS. ROLLABLE RIBBON ONLY.
3. UNITS: INCHES [mm]


| | |
|-----------|-----|
| 660105059 | A |
| MID | REV |

| COMMSCOPE, INC. | | | | | | | | | |
|--|-----------------|---------------|-------------|---|---------------------|--------------|---------|--------|----------|
| TOLERANCES | | | | | SAP MATERIAL MASTER | | | | |
| SEE TABLE | | | | | | | | | |
| FINISH | | | | | MATERIAL | | | | |
| SEE NOTES | | | | | SEE NOTES | | | | |
| UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN MILLIMETERS | DRAFTER | | | TITLE | | | | | |
| | R. SCHOENFELDER | | | INSTALLATION DRAWING, SPLICE CABINET ODF-SPLCAB-12 | | | | | |
| | CHECKER | | | SIZE | SCALE | DOCUMENT NO. | | | |
| | J. ANDERSON | | | A2 | 0.100 | A19009077 | | | |
| CMO | | | 40105152CMO | | | | | | |
| ALL SURFACES | | WORK AREA: 58 | | MODEL | | DRAWING | | SHEET | |
| ✓ | | [Symbol] | | VERSION | STATUS | REVISION | VERSION | STATUS | REVISION |
| | | | | 00 | | | 00 | RE | A |
| | | | | | | | | | 1 OF 3 |


© 2020 CommScope, Inc. Confidential
NOTICE: These drawings and specifications are the proprietary property of COMMSCOPE, INC. and may be used only for the specific purpose authorized in writing by COMMSCOPE, INC.

SPLICE CABINET ODF-SPLCAB-12


4 POST RACK OR CABINET MOUNTING

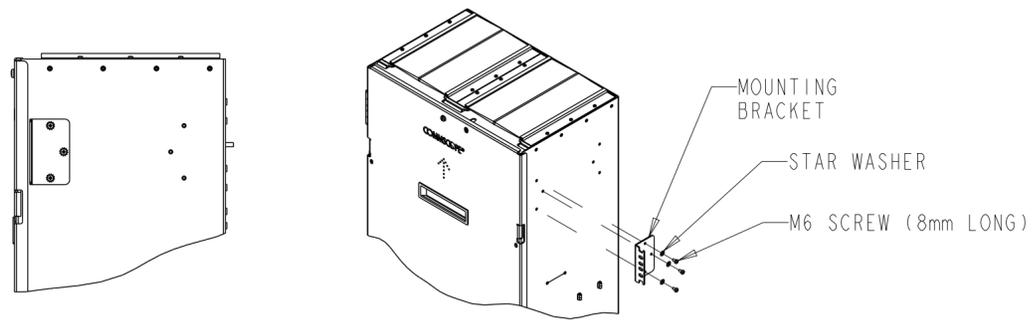

CABINET OR 4 POST RACK
MOUNTING BRACKET POSITION

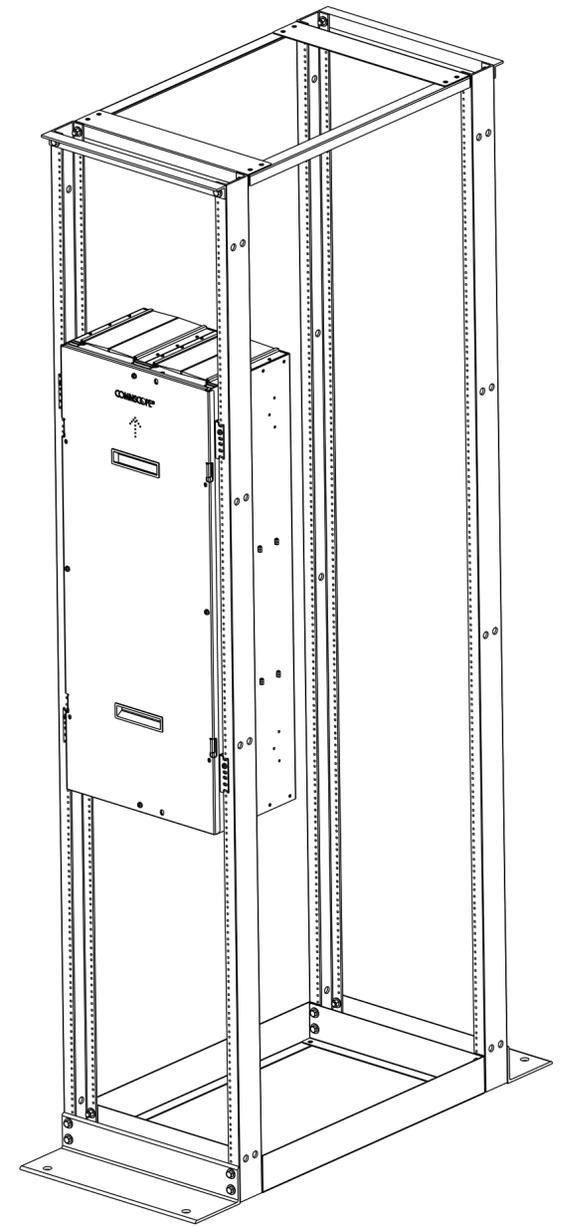


RACK MOUNT SPLICE CABINET
IMPORTANT: MOUNT SPLICE CABINET TO RACK
WITH DOOR FASTENED TO CABINET.



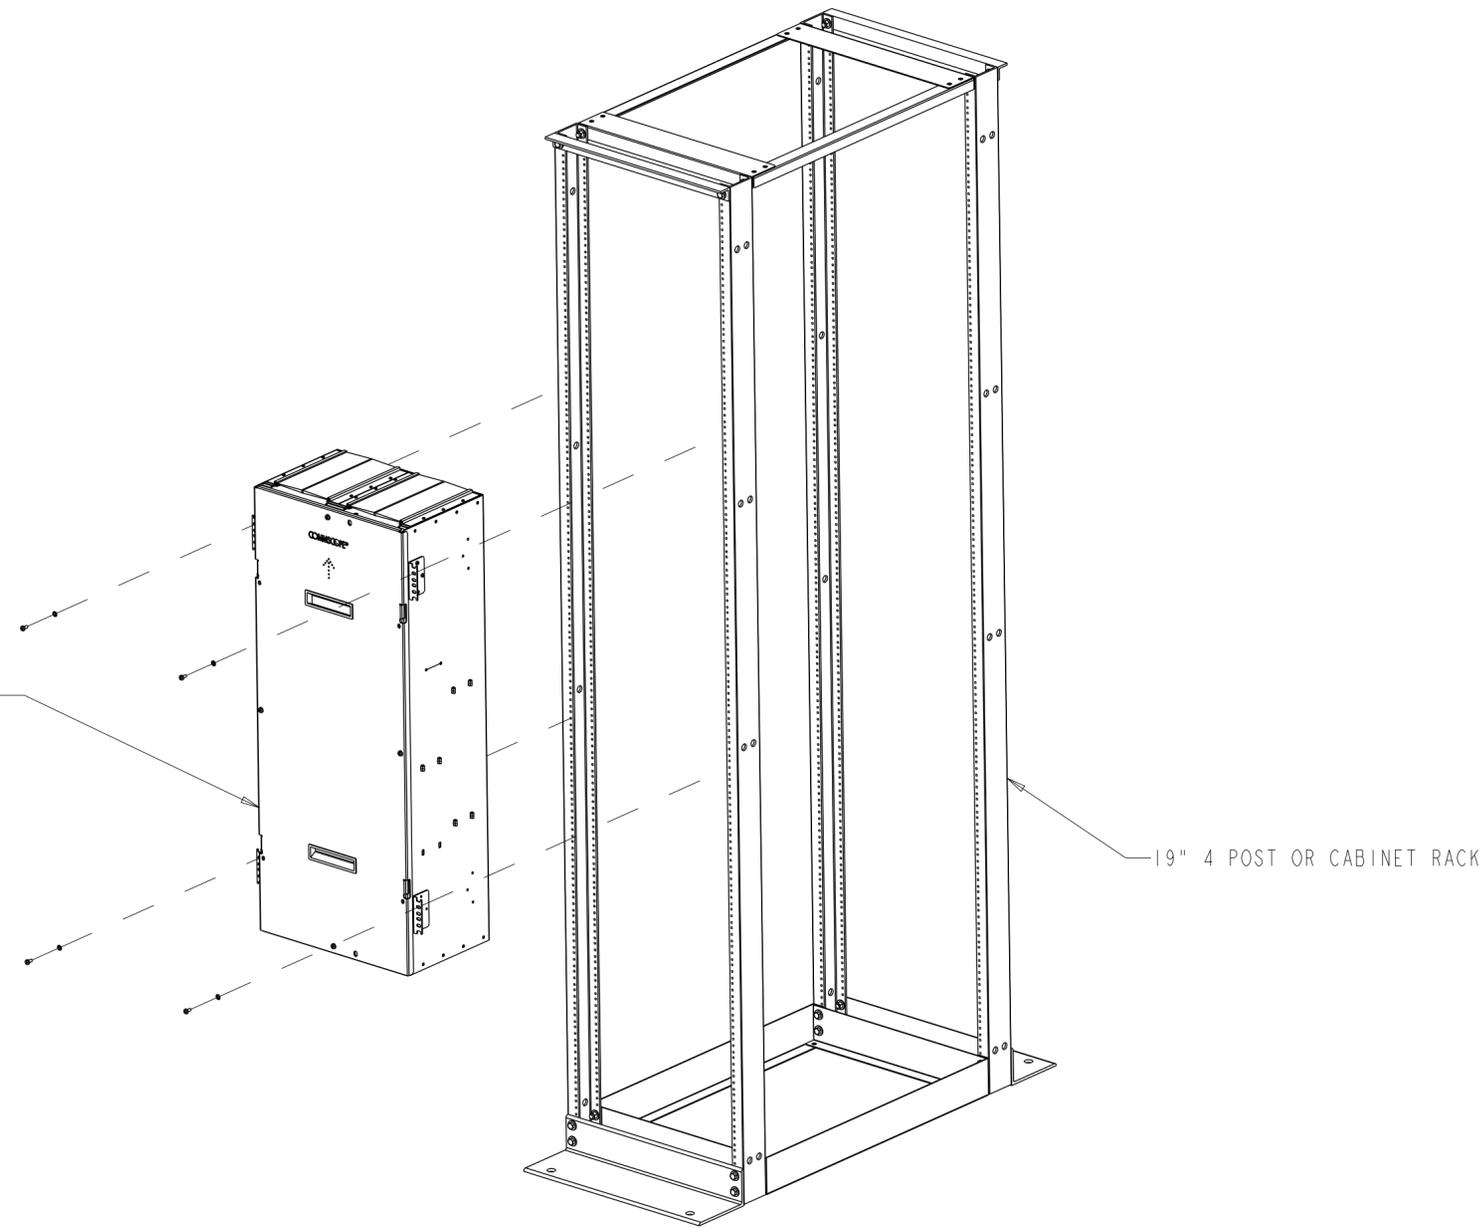


| | | | |
|---|--------|------------------|--------|
| COMMSCOPE, INC. | | | |
| TITLE | | | |
| INSTALLATION DRAWING, SPLICE CABINET ODF-SPLCAB-12 | | | |
| SIZE | SCALE | DOCUMENT NO. | |
| A2 | 0.100 | A19009077 | |
| DRAWING | | | SHEET |
| VERSION | STATUS | REVISION | 2 OF 3 |
| 00 | RE | A | |

© 2020 CommScope, Inc. Confidential
NOTICE: These drawings and specifications are the proprietary property of COMMSCOPE, INC. and may be used only for the specific purpose authorized in writing by COMMSCOPE, INC.

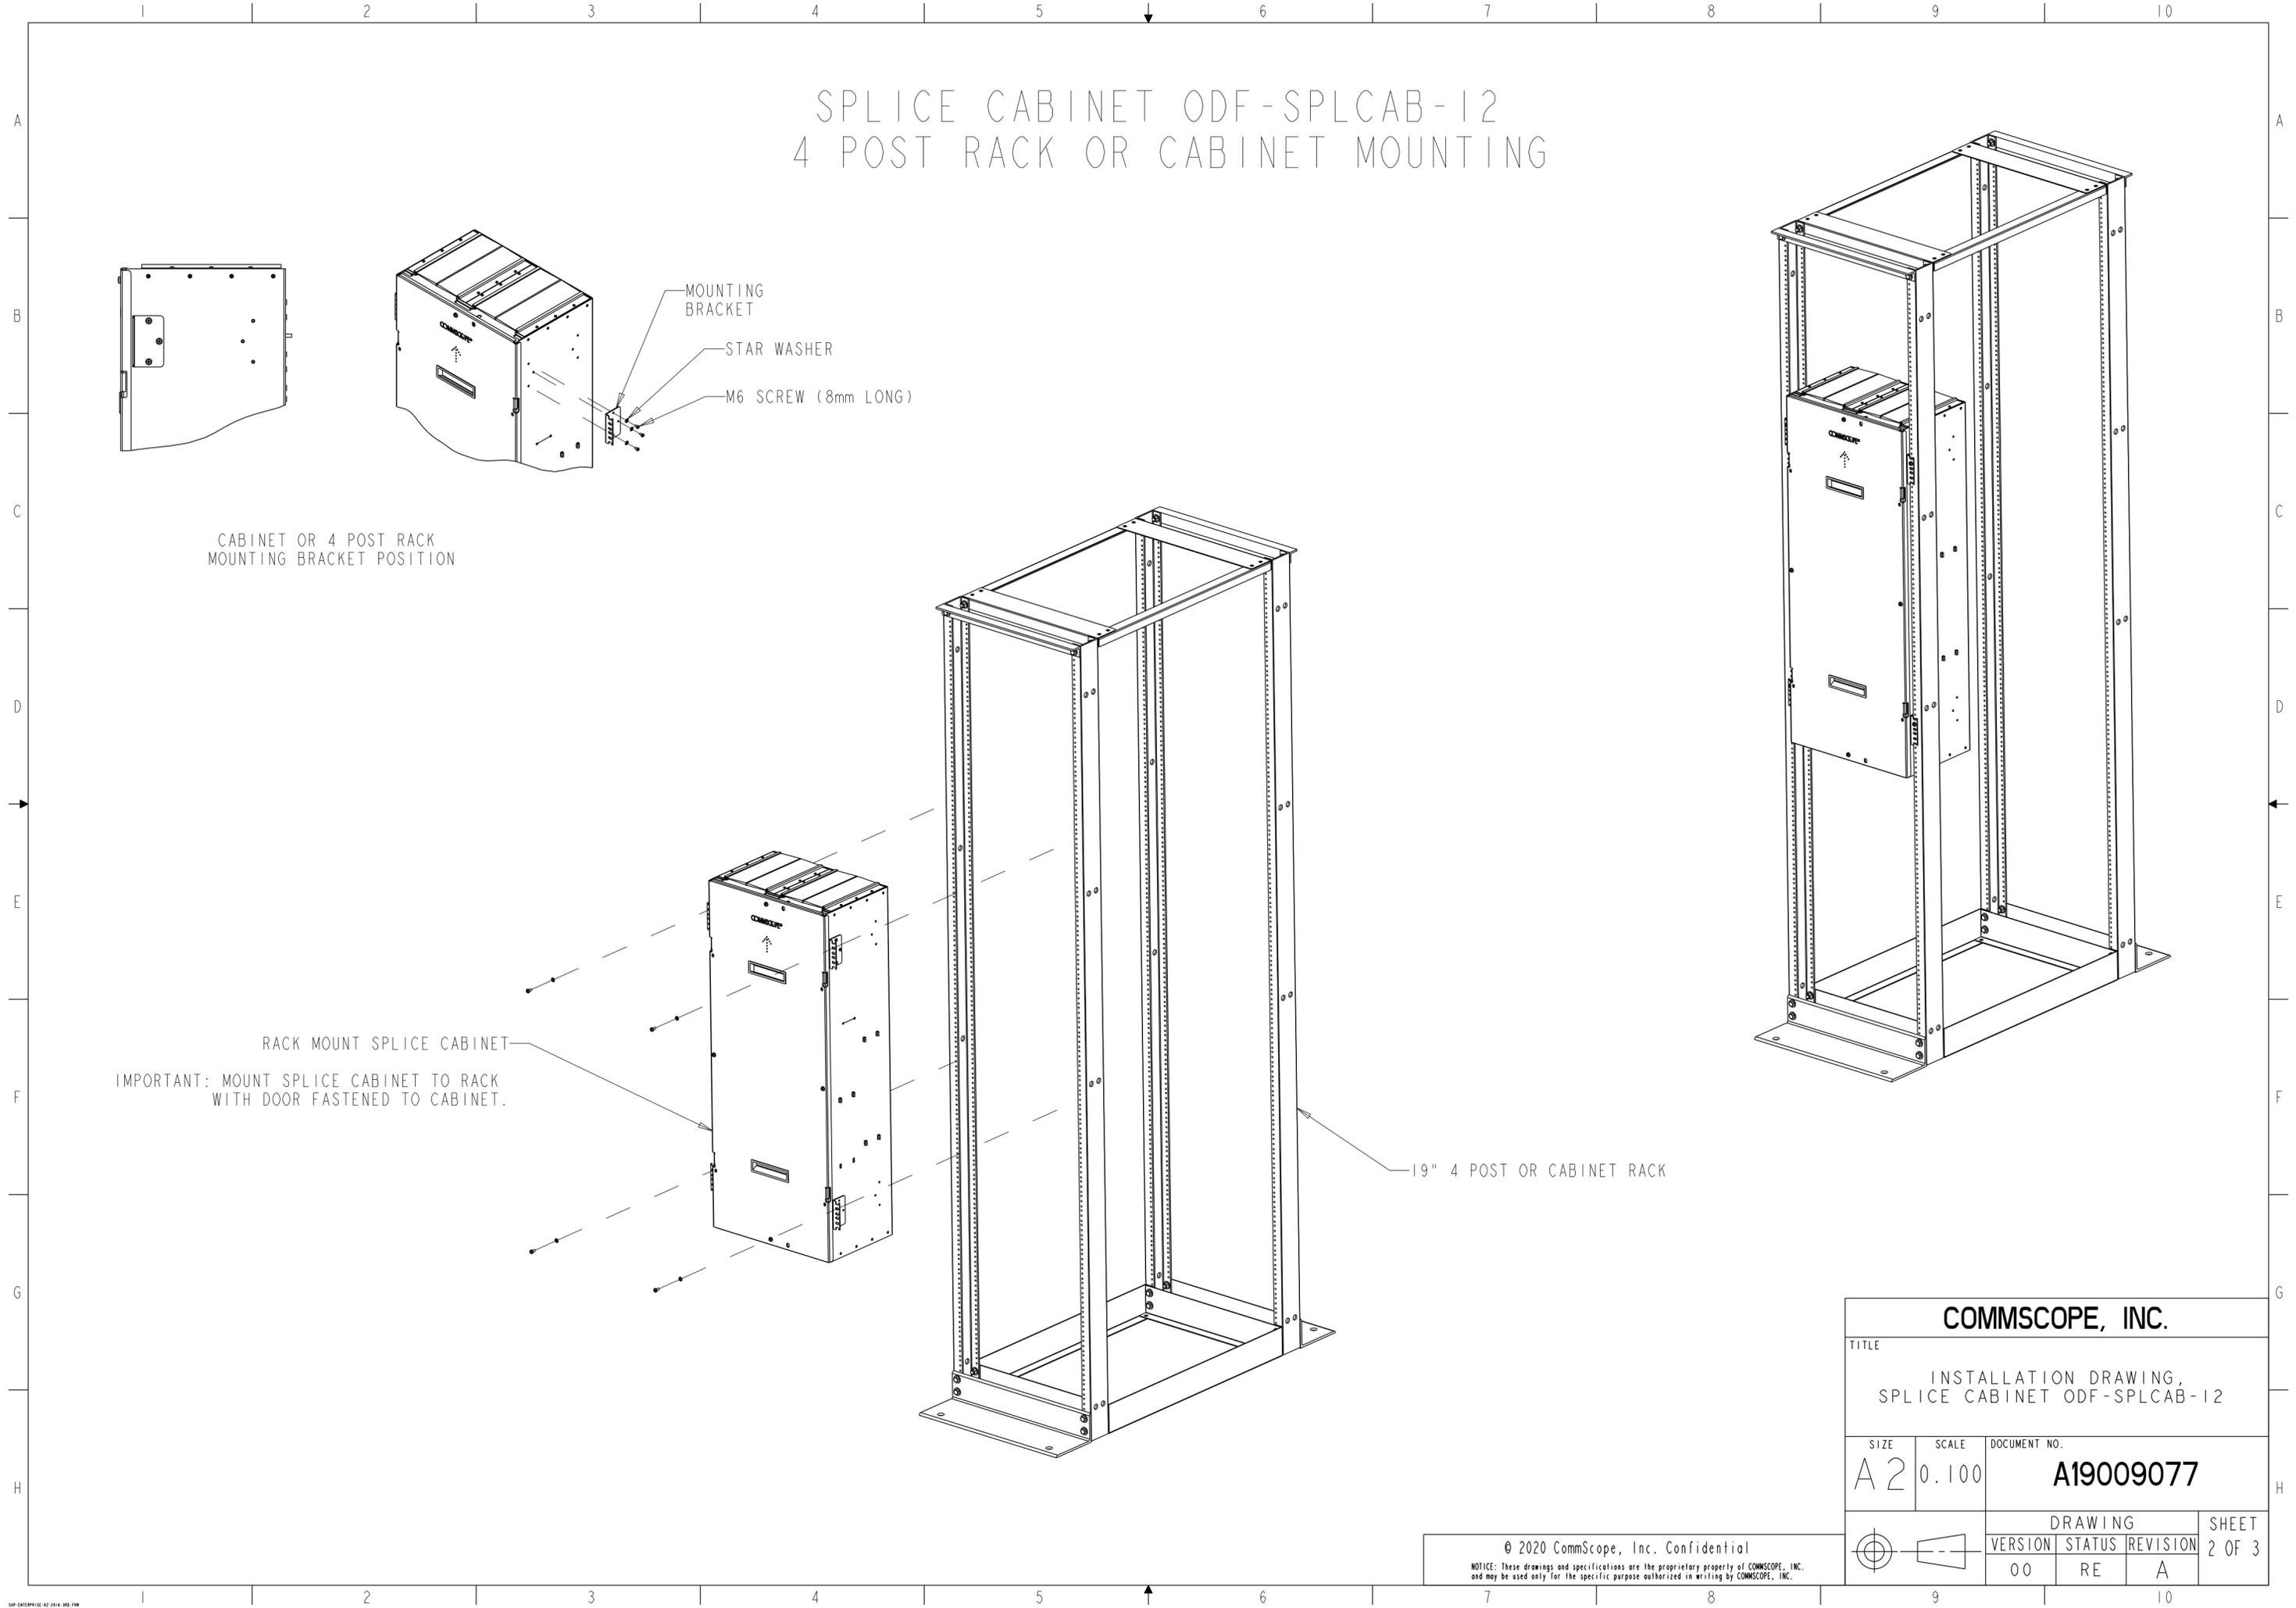

SPLICE CABINET ODF-SPLCAB-12 WALL MOUNTING

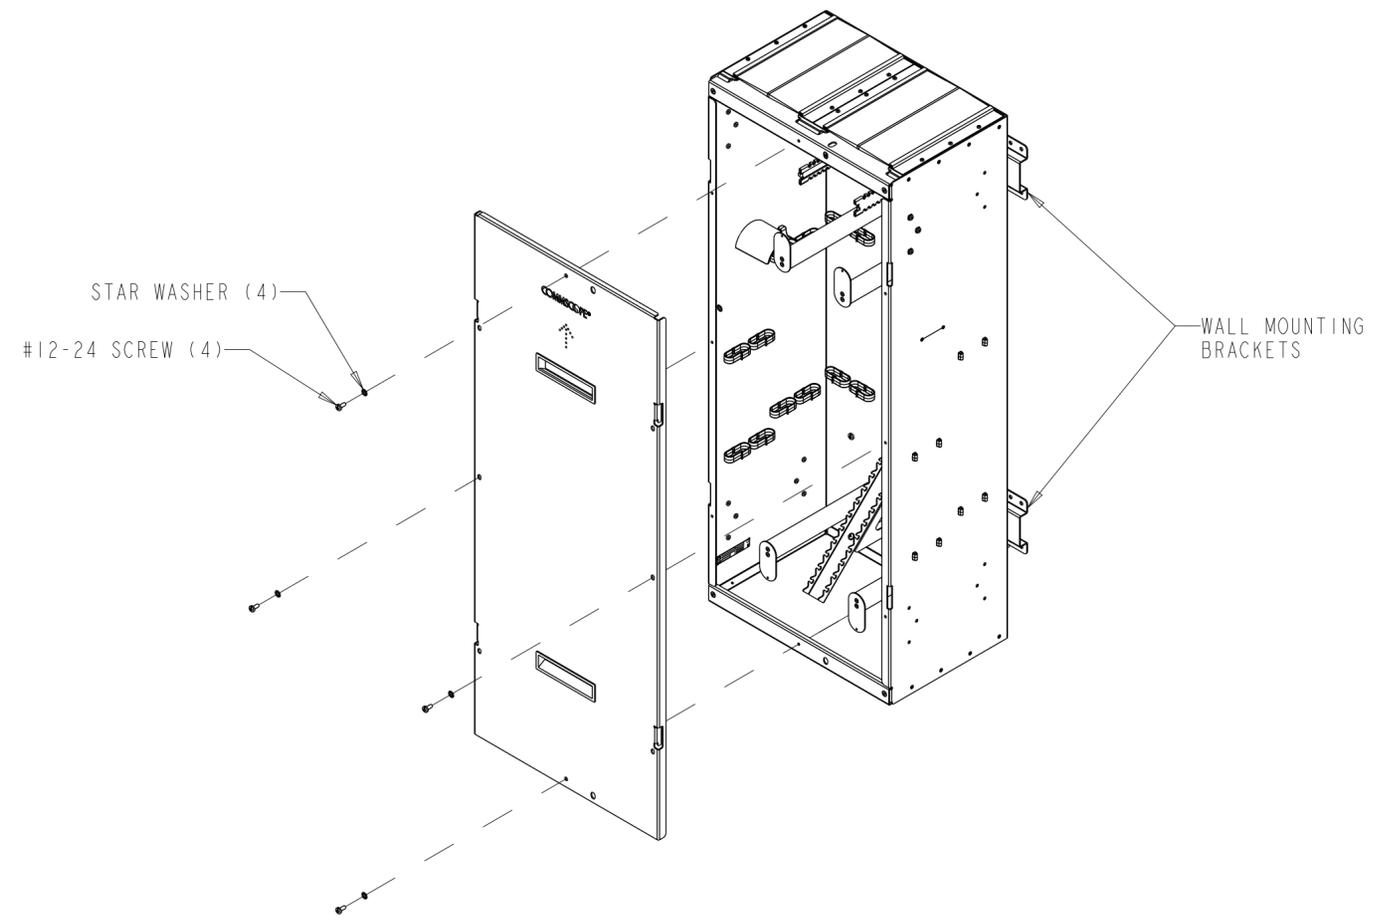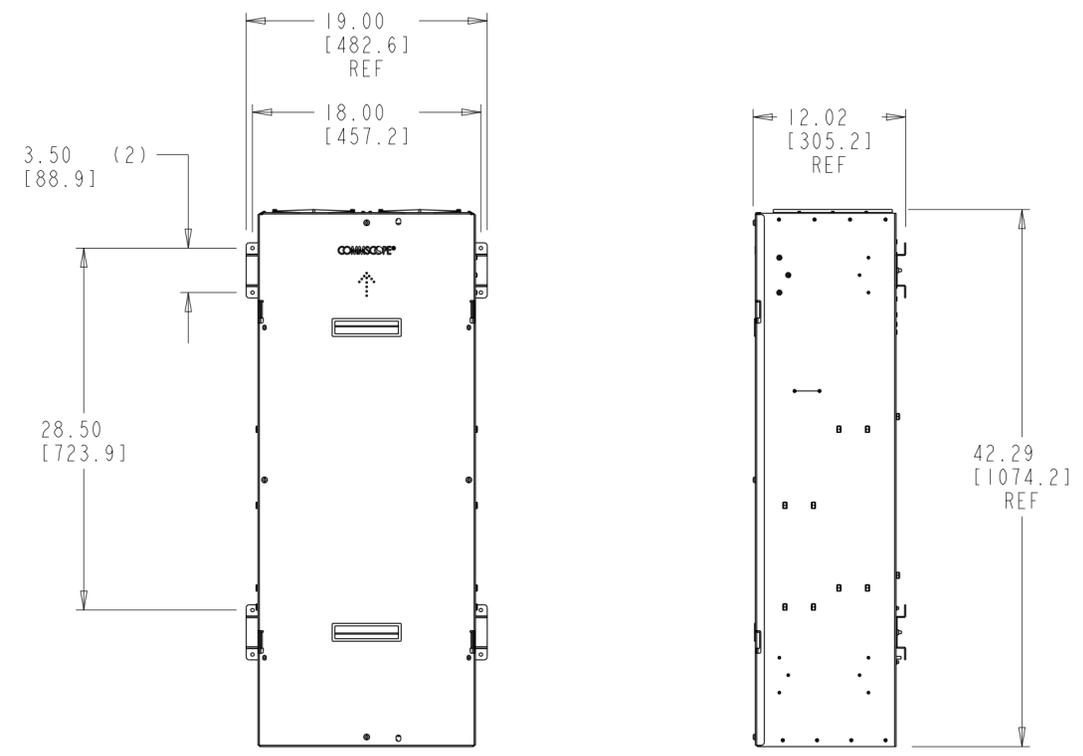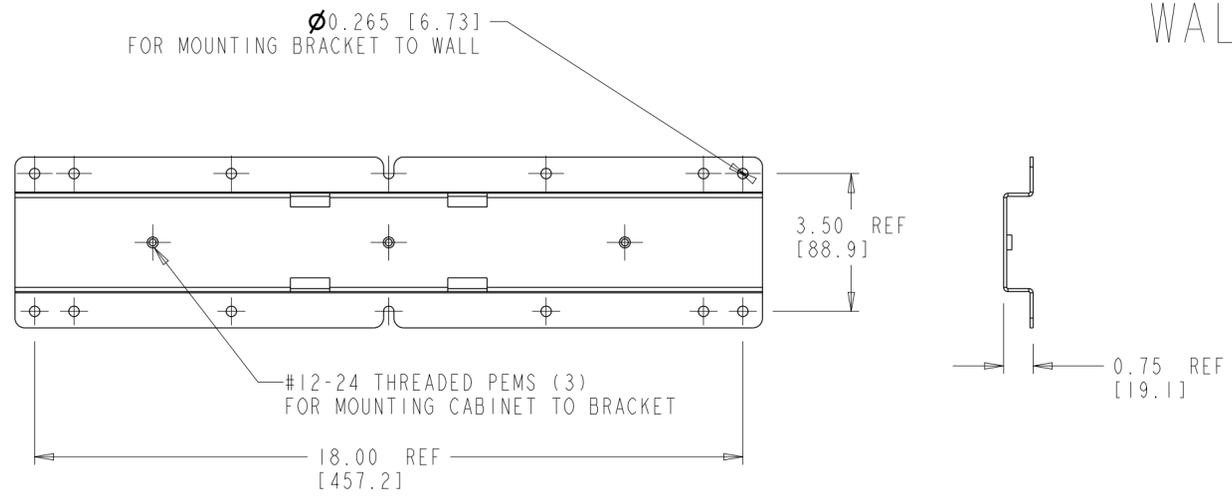

NOTES:

1. ATTACH SPLICE CABINET TO MOUNTING BRACKETS WITH #12-24 SCREWS.
2. ATTACH MOUNTING BRACKETS TO WALL WITH 1/4" DIA. OR SMALLER FASTENERS.

| | | | |
|---|--------|------------------|--------|
| COMMSCOPE, INC. | | | |
| TITLE | | | |
| INSTALLATION DRAWING, SPLICE CABINET ODF-SPLCAB-12 | | | |
| SIZE | SCALE | DOCUMENT NO. | |
| A2 | 0.100 | A19009077 | |
| DRAWING | | | SHEET |
| VERSION | STATUS | REVISION | 3 OF 3 |
| 00 | RE | A | |

© 2020 CommScope, Inc. Confidential
 NOTICE: These drawings and specifications are the proprietary property of COMMSCOPE, INC. and may be used only for the specific purpose authorized in writing by COMMSCOPE, INC.

